
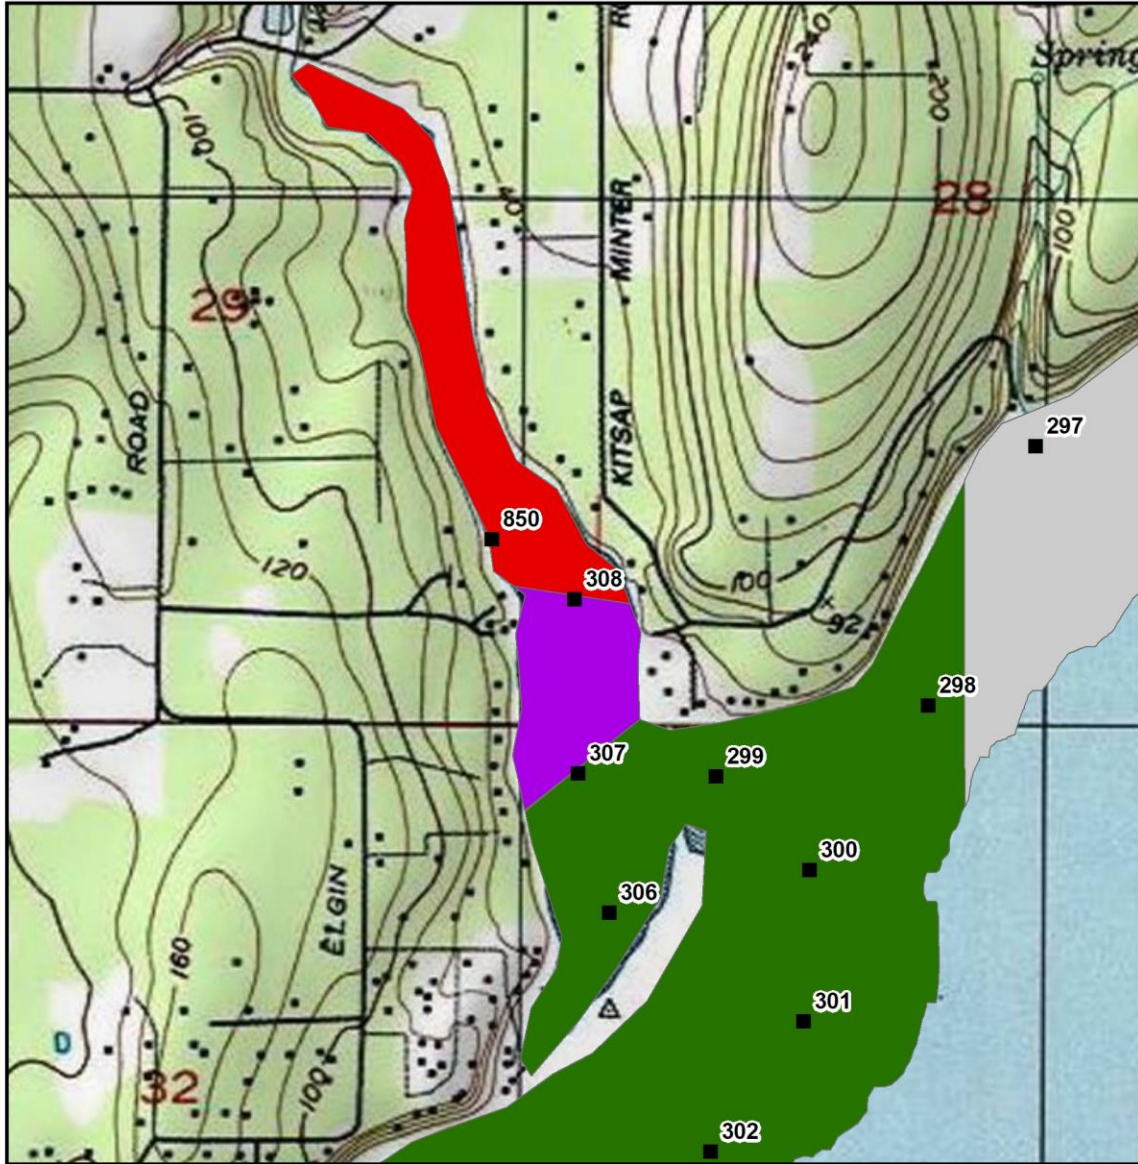


# MINTER BAY


Henderson Bay



## Classification

- Approved
- Conditional
- Prohibited
- Restricted
- Unclassified

## Sampling Stations



## Minter Bay Summary of Marine Water Data (last 30 samples)

Station Number	Classification	Date Range	Range (FC/100 mL)	GeoMean (FC/100 mL)	Est. 90 <sup>th</sup> Percentile (FC/100 mL)	Meets Standard
298	Approved	6/15/2017 - 3/23/2022	1.7 - 70.0	2.1	5.4	Yes
299	Approved	6/15/2017 - 3/23/2022	1.7 - 17.0	2.8	7.6	Yes
300	Approved	6/15/2017 - 3/23/2022	1.7 - 15.0	2.1	4.1	Yes
301	Approved	6/15/2017 - 3/23/2022	1.7 - 7.8	1.8	2.6	Yes
302	Approved	6/15/2017 - 3/23/2022	1.7 - 4.5	1.9	2.3	Yes
306	Approved	8/28/2017 - 3/23/2022	1.7 - 17.0	3.3	9.4	Yes
307	Approved	6/15/2017 - 3/23/2022	1.7 - 49.0	3.6	13.6	Yes
308	Restricted	6/15/2017 - 3/23/2022	1.7 - 130.0	4.8	27.9	Yes
881	Restricted	9/28/2020 - 3/23/2022	1.7 - 13.0	3.7	10.1	*N/A
850	Prohibited	6/15/2017 - 3/23/2022	1.7 - 130.0	7.3	41.4	Yes

The standard for approved shellfish growing waters is fecal coliform geometric mean not greater than 14 organisms / 100 mL with an estimated 90th percentile not greater than 43 organisms / 100 mL. The above table shows bacteriological results in relation to program standards.

\*N/A – SRS criteria require a minimum of 30 samples from each station. Station 881 only has 10 samples.

## Minter Bay Change in Estimated 90<sup>th</sup> Percentile at each Station from Annual Report Period to Current Period

Station Number	Classification	2021 ANNUAL REPORT Est 90th Percentile	CURRENT Est 90th Percentile	Change in Est 90th Percentile	>3 Decrease or Increase
298	Approved	6.5	5.4	-1.1	
299	Approved	7.6	7.6	0.0	
300	Approved	5.7	4.1	-1.6	
301	Approved	2.9	2.6	-0.3	
302	Approved	2.3	2.3	0.0	
306	Approved	9.6	9.4	-0.2	
307	Approved	16.8	13.6	-3.2	Decrease
308	Restricted	35.9	27.9	-8.0	Decrease
850	Prohibited	51.6	41.4	-10.2	Decrease

# Fecal Coliform Rolling Estimated 90<sup>th</sup> Percentiles in Minter Bay

